

"SS15-16" CEE CLOSURE
(FIELD CUT AND FORM)

1/4-14 x 7/8" SDWW
(3/PANEL)

PANNED ENDS OF
ROOF PANELS

1/4-14 x 7/8" SDWW
@ 8" O/C.

3/32" x 1/2" SEALER
TAPE "ST3" ~ CONT.

CAULKING @ VERT.
LEGS OF PANELS

1/8" x 1 5/8" SEALER
TAPE "ST2"

"FSS-1.5" ROOF
PANELS

"GT3" HI-EAVE
TRIM

ROOF CLIP


1/4-14 x 7/8" SDWW

#10 x 1/2" PHILLIPS
DRIVE PANHEADS
(2/CLIP)


CLOSURES

"FLEXOSPAN"
SIDING
PANELS

MARK	PITCH	"A" DIM.
GT31	1:12	85°
GT32	2:12	80°
GT33	3:12	76°
GT34	4:12	72°
GT35	5:12	67°

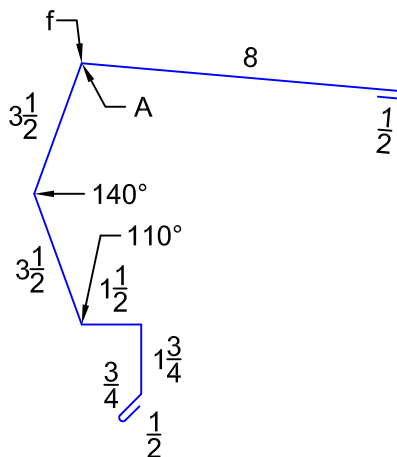

"GT3" HI-EAVE TRIM



"SS15-16" CEE CLOSURE

ERECTOR NOTES:

1. THE ENDS OF ALL ROOF PANELS TO BE PANNED PRIOR TO INSTALLING THE "SS15-16" CEE CLOSURES.
2. THE ENDS OF HIGH EAVE TRIM TO BE CAULKED AND LAPPED 4" AWAY FROM PREVAILING WIND.
3. "SS15-16" CEE CLOSURE TO BE FIELD CUT AND FORMED AS SHOWN ON PAGE "FSS15-6".



BOX 515 RAILROAD STREET
SANDY LAKE, PENNSYLVANIA 16145-0515
PHONE: 800-245-0396 ° FAX: 724-376-3864

"FSS-1.5" STANDING SEAM DETAILS

DRAWN BY:

D. JUREY

DATE:

12-5-25

CHECKED BY:

DATE:

HIGH EAVE DETAIL

DRAWING NO.

FSSI5-16