




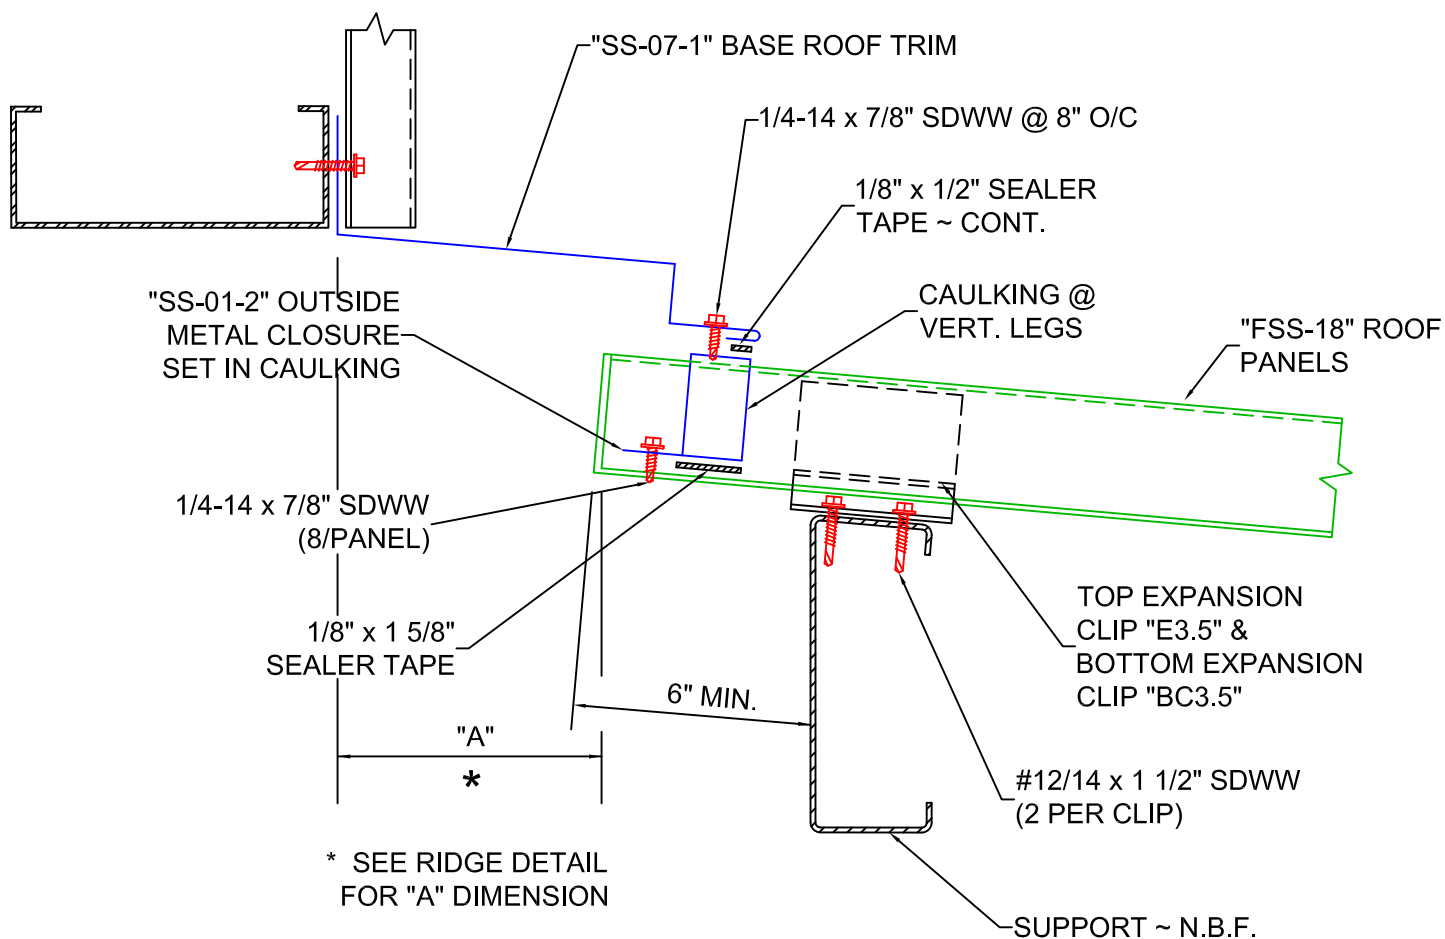

12 $\frac{3}{8}$

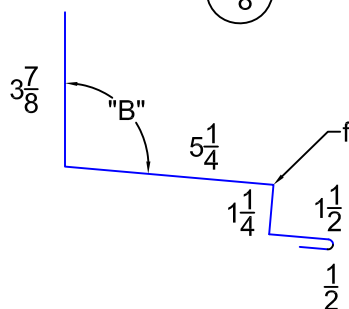

"SS-07-1" BASE ROOF TRIM

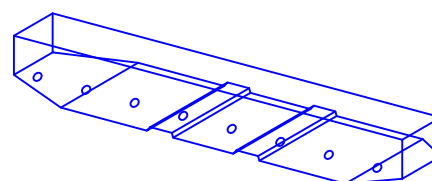

"SS-01-2" OUTSIDE METAL CLOSURE

ERECTOR NOTES:

1. THE "SS-07-1" SHOULD BE CAULKED AND LAPPED 4" AWAY FROM PREVAILING WIND. BASE ROOF TRIM SHOULD BE STITCHED TOGETHER AT ENDS USING TWO 1/4-14 x 7/8" SDWW FASTENERS.
2. THE ENDS OF ROOF PANELS TO BE POSITIONED "A" AWAY FROM GIRT LINE.
2. "B" DIMENSION VARIES AS NECESSARY TO MATCH ROOF PITCH.



BOX 515 RAILROAD STREET
SANDY LAKE, PENNSYLVANIA 16145-0515
PHONE: 800-245-0396 • FAX: 724-376-3864

"FSS-18" STANDING SEAM DETAILS

DRAWN BY:

D. JUREY

DATE:

12-2-25

CHECKED BY:

DATE:

HIGH EAVE - BASE ROOF
DETAIL

DRAWING NO.

FSSI8-17